


PIPE SPECIFICATION (SCALE 1:15)


PRODUCT CODE:	P1192600
A - PIPE INNER DIAMETER	1950 mm
B - PIPE OUTER DIAMETER	2032 mm
C - SPIGOT OUTER DIAMETER	2044 mm
D - SOCKET OUTER DIAMETER	2058 mm
E - SOCKET OUTER DIAMETER INCLUDING FLARE	2070 mm
F - EFFECTIVE LENGTH	2600 mm
G - OVERALL LENGTH	2780 mm
NOMINAL WEIGHT (KG)	302 kg
NO. OF PIPES PER FULL LOAD	6
METRES PER FULL LOAD	15.6 m

STUBS:	
NOMINAL DIAMETER	1950 mm
EFFECTIVE LENGTH	1300 mm
PRODUCT CODE - PLAIN END/SPIGOT	P1191301
PRODUCT CODE - PLAIN END/SOCKET	P1191302
SHORT-TERM RING STIFFNESS	2.5 kN/M ²
LONG-TERM RING STIFFNESS	2.2 kN/M ²

NOTE: MANUFACTURING TOLERANCES ON ALL DIAMETERS TO ±6mm AND ALL LENGTHS TO ±50mm

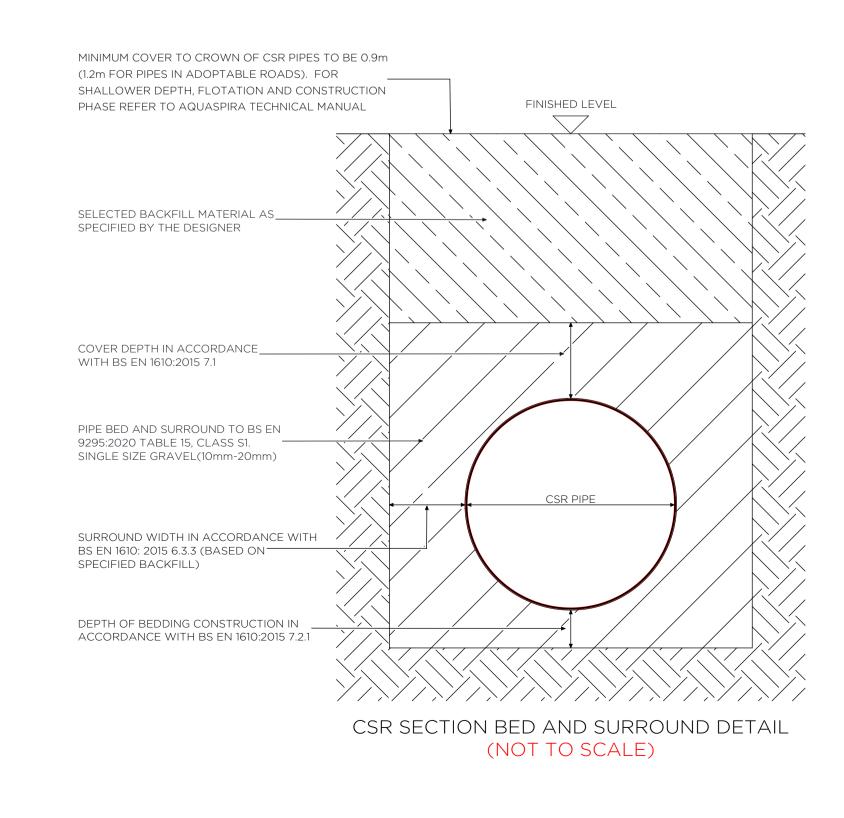


FOR SITE SPECIFIC DRAWINGS, DIMENSIONS AND STRUCTURAL CALCULATIONS, PLEASE EMAIL tech@aquaspira.com or TEL: 01282 608510

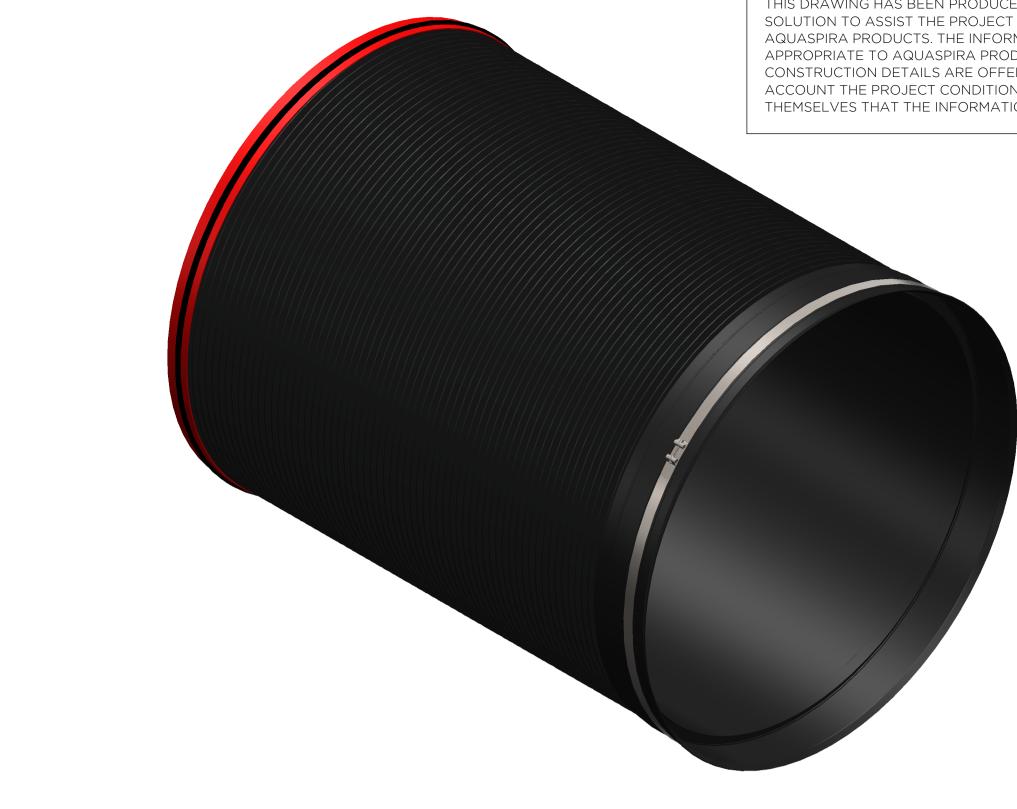

ISOMETRIC VIEW (SCALE 1:15)

<u>NOTE:</u>

BS EN 9295:2020 SECTION A.10.3 STATES THAT ROCKER PIPES ARE NOT REQUIRED FOR AQUASPIRA PIPES. THIS DETAIL SHOWS A METHOD FOR BUILDING PIPES INTO MANHOLES UTILIZING HALF-LENGTH PIPES WHERE IT IS NOT PRACTICAL TO BUILD IN FULL LENGTH PIPES.

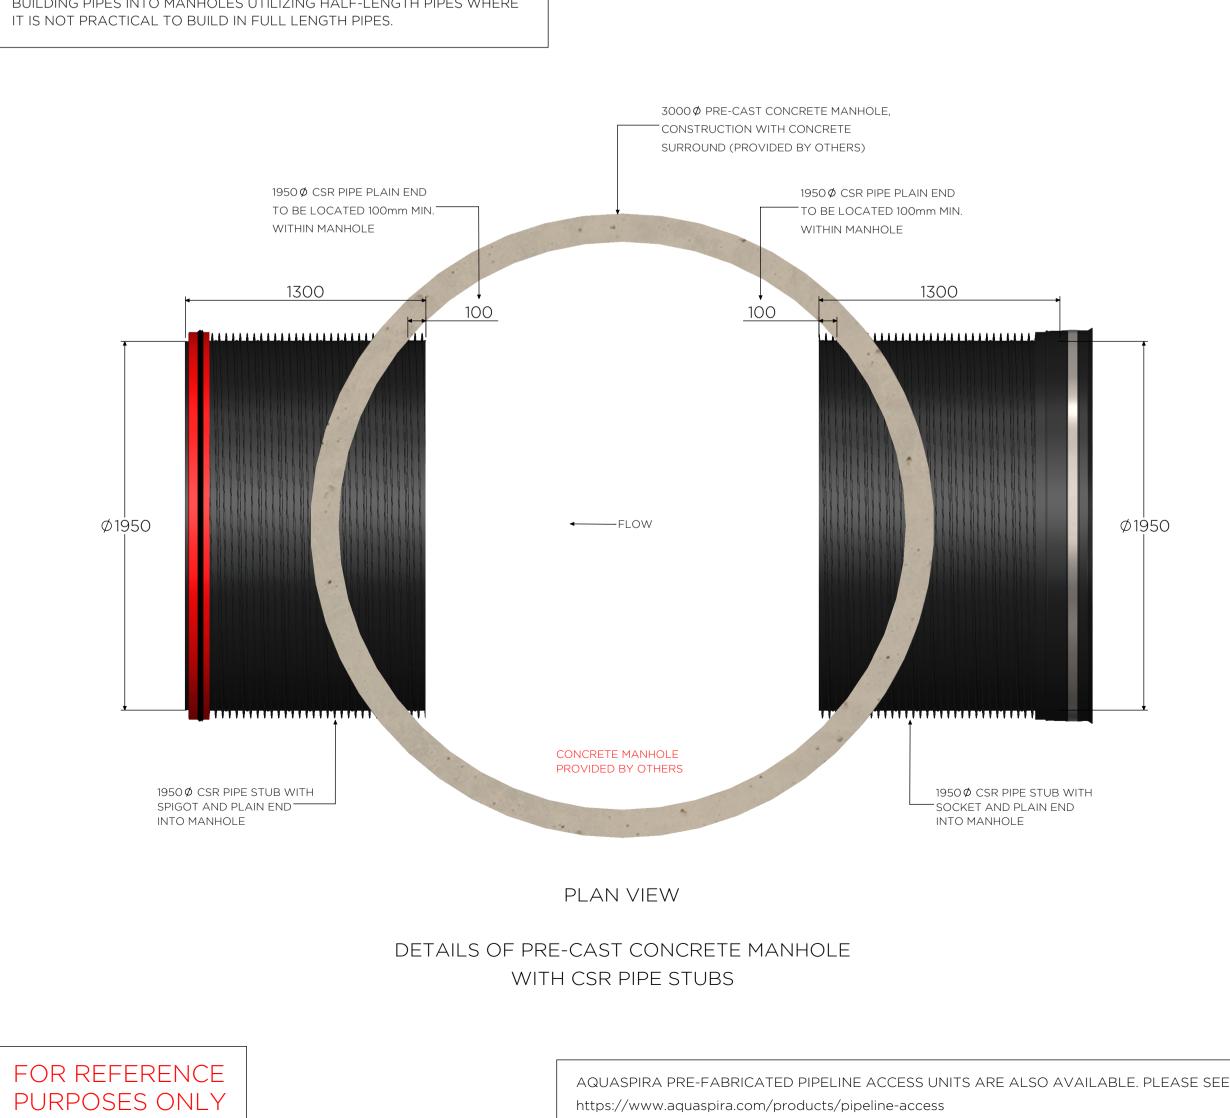

<u>NOTE</u>:

THIS DRAWING HAS BEEN PRODUCED FOR THE PURPOSE OF OFFERING A PROPOSED SOLUTION TO ASSIST THE PROJECT ENGINEER WHEN ASSESSING THE SUITABLITY OF AQUASPIRA PRODUCTS. THE INFORMATION CONTAINED IN THIS DRAWING IS APPROPRIATE TO AQUASPIRA PRODUCTS ONLY. ALL REFERENCES TO ASSOCIATED CONSTRUCTION DETAILS ARE OFFERED AS TYPICAL DETAILS AND DO NOT TAKE INTO ACCOUNT THE PROJECT CONDITIONS. THE PROJECT ENGINEER/S MUST SATISFY THEMSELVES THAT THE INFORMATION PROVIDED IN THIS DRAWING IS SATISFACTORY.

<u>NOTE:</u>

- 1. FOR DETAILS OF TRADITIONAL MANHOLE CONSTRUCTION REFER TO SEWERS FOR ADOPTION OR SEWERS FOR SCOTLAND.
- 2. ALL DIMENSIONS ARE NOMINAL AND IN MILLIMETERS UNLESSS OTHERWISE SPECIFIED.
- 3. PLEASE REFER TO AQUASPIRA TECHNICAL MANUAL AND SITE HANDBOOK FOR DETAILED INFORMATION ON PIPE INSTALLATION.
- 4. ALL STAINLESS STEEL TO BE GRADE 304 AND 4mm THICK, UNLESS OTHERWISE SPECIFIED.
- 5. ALL PIPE SPECIFIED TO BE AQUASPIRA CSR PIPE.

PIPE BEDDING NOTES:

- . PROCESSED GRANULAR MATERIAL TO INCLUDE AGGREGATES TO BS EN 12620:2002 AIR-COOLED BLAST FURNACE SLAG TO BS EN 12620:2002 AND LIGHTWEIGHT AGGREGATES TO BS EN 13055:2016.
- 2. ALL TEMPORARY ENABLING WORKS ARE BY OTHERS.
- 3. PROJECT ENGINEERS TO CONFIRM THE BACKFILL DETAILS ARE APPROPRIATE FOR THE SITE GROUND CONDITIONS AND LOADING CRITERIA.
- 4. DURING CONSTRUCTION, HA40/01 SECTION 2.3 RECOMMENDS MINIMUM 1m COVER FOR PIPES SUBJECT TO CONSTRUCTION TRAFFIC LOADING.
- 5. RECLAIMED AND SITE WON MATERIAL TO BE REVIEWED AND APPROVED BY MAIN PROJECT ENGINEER PRIOR TO USE AS BACKFILL.
- WHERE MINIMUM COVER DEPTHS SHOWN CANNOT BE ACHIEVED, A REINFORCED CONCRETE PROTECTION SLAB IS REQUIRED. FOR DETAILS PLEASE SEE AQUASPIRA TECHNICAL MANUAL.

FLOTATION:

PIPES ABOVE 1500 Ø MAY REQUIRE MORE THAN 900mm COVER. PLEASE REFER TO AQUASPIRA TECHNICAL MANUAL.

aquaspira

Drawing Title:

CONSTRUCTION DETAIL AND DATA SHEET -1950Ø CSR PIPE 2.6m

P1192600

A1

Scale: Drawn: Checked: Date: AS SHOWN JA

Drawing No: